


COGENERATION INSTALLATION

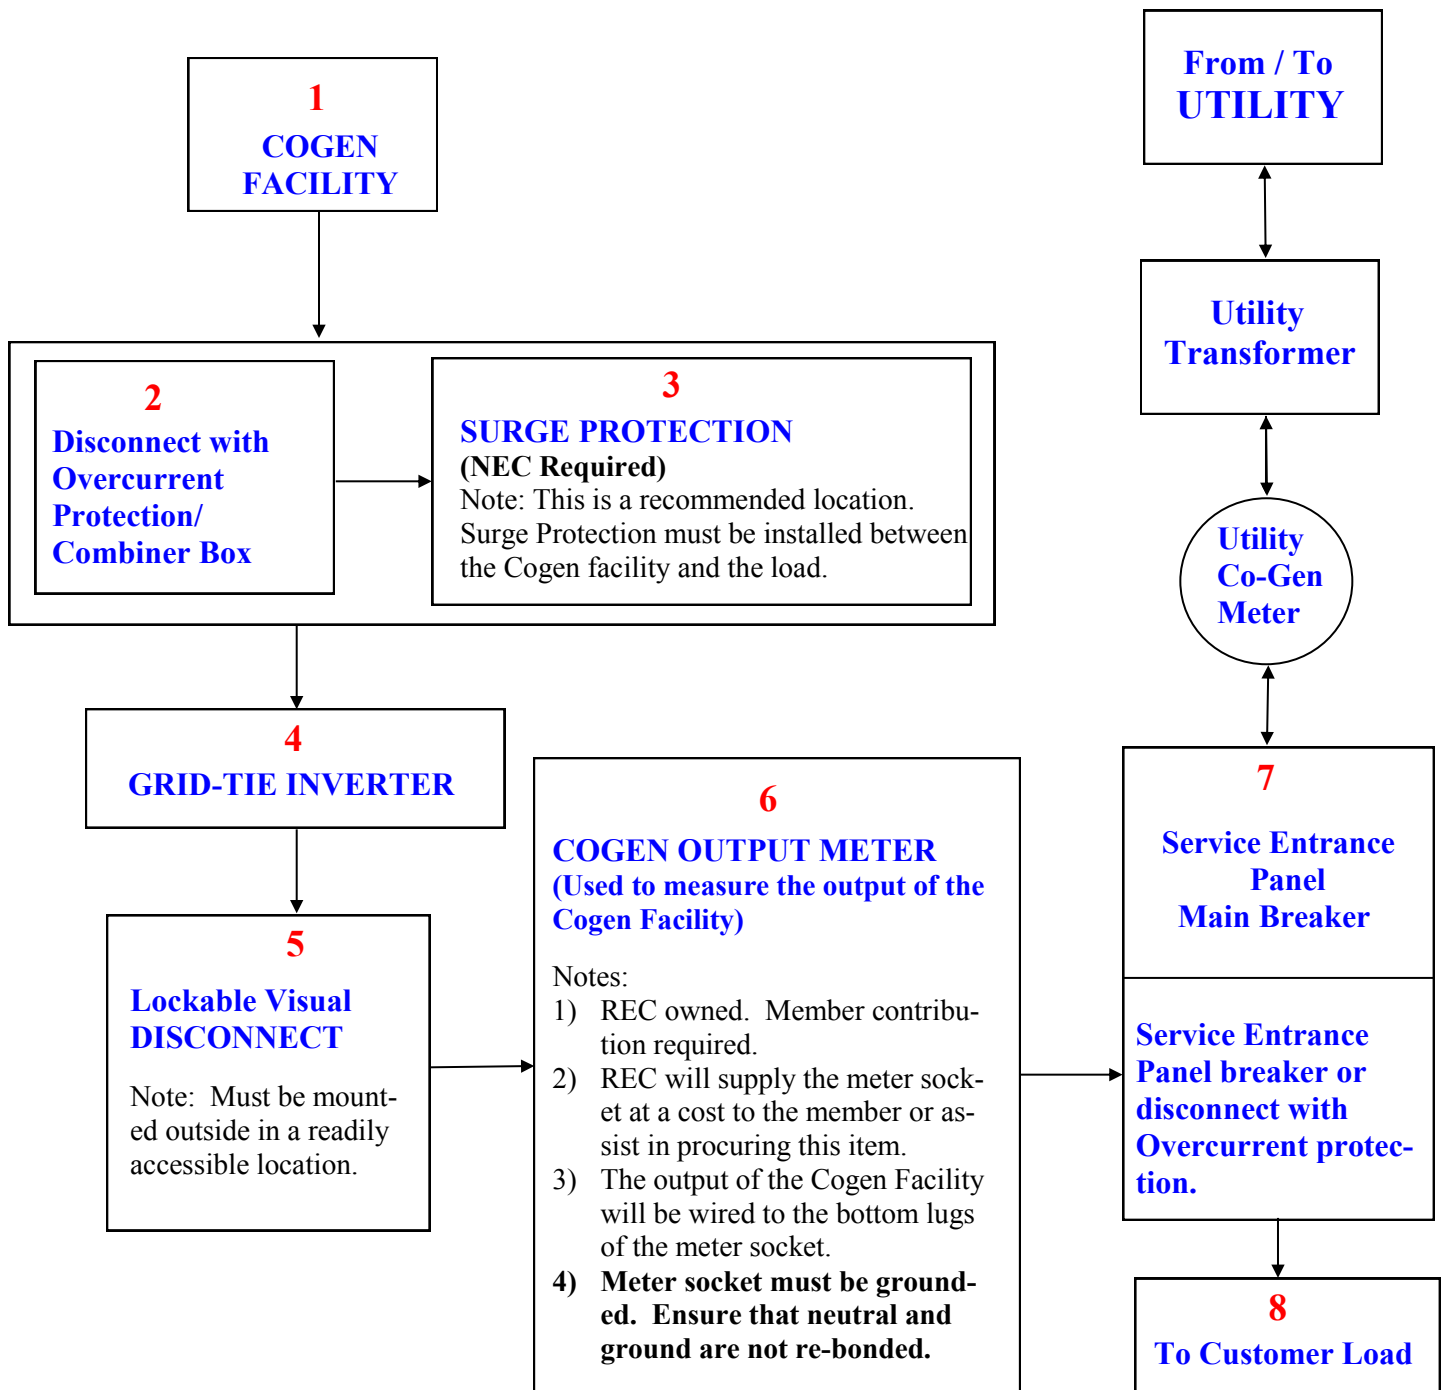

Additional Information:

- 1) Heat sub meters are not allowed in combination with Cogen installations.
- 2) We recommend your electrician discuss the installation with an electrical inspector to ensure all NEC wiring and labeling requirements are adhered to.
- 3) To qualify for net metering—the total output of all Cogen generation must not exceed 40 Kw as measured by the Cogen output meter. If the output exceeds 40 Kw, the cooperative contract will be void.
- 4) This installation must be approved by a state certified inspector.
- 5) Solar Array must be tied into line side of Transfer Switch if member has generator.