


ALLAMAKEE-CLAYTON ELECTRIC COOPERATIVE, INC.

Wiring/Service Specifications and Recommendations

Phone: 1-888-788-1551 or 563-846-7611

Meter Panel: Underground Source - Underground Load

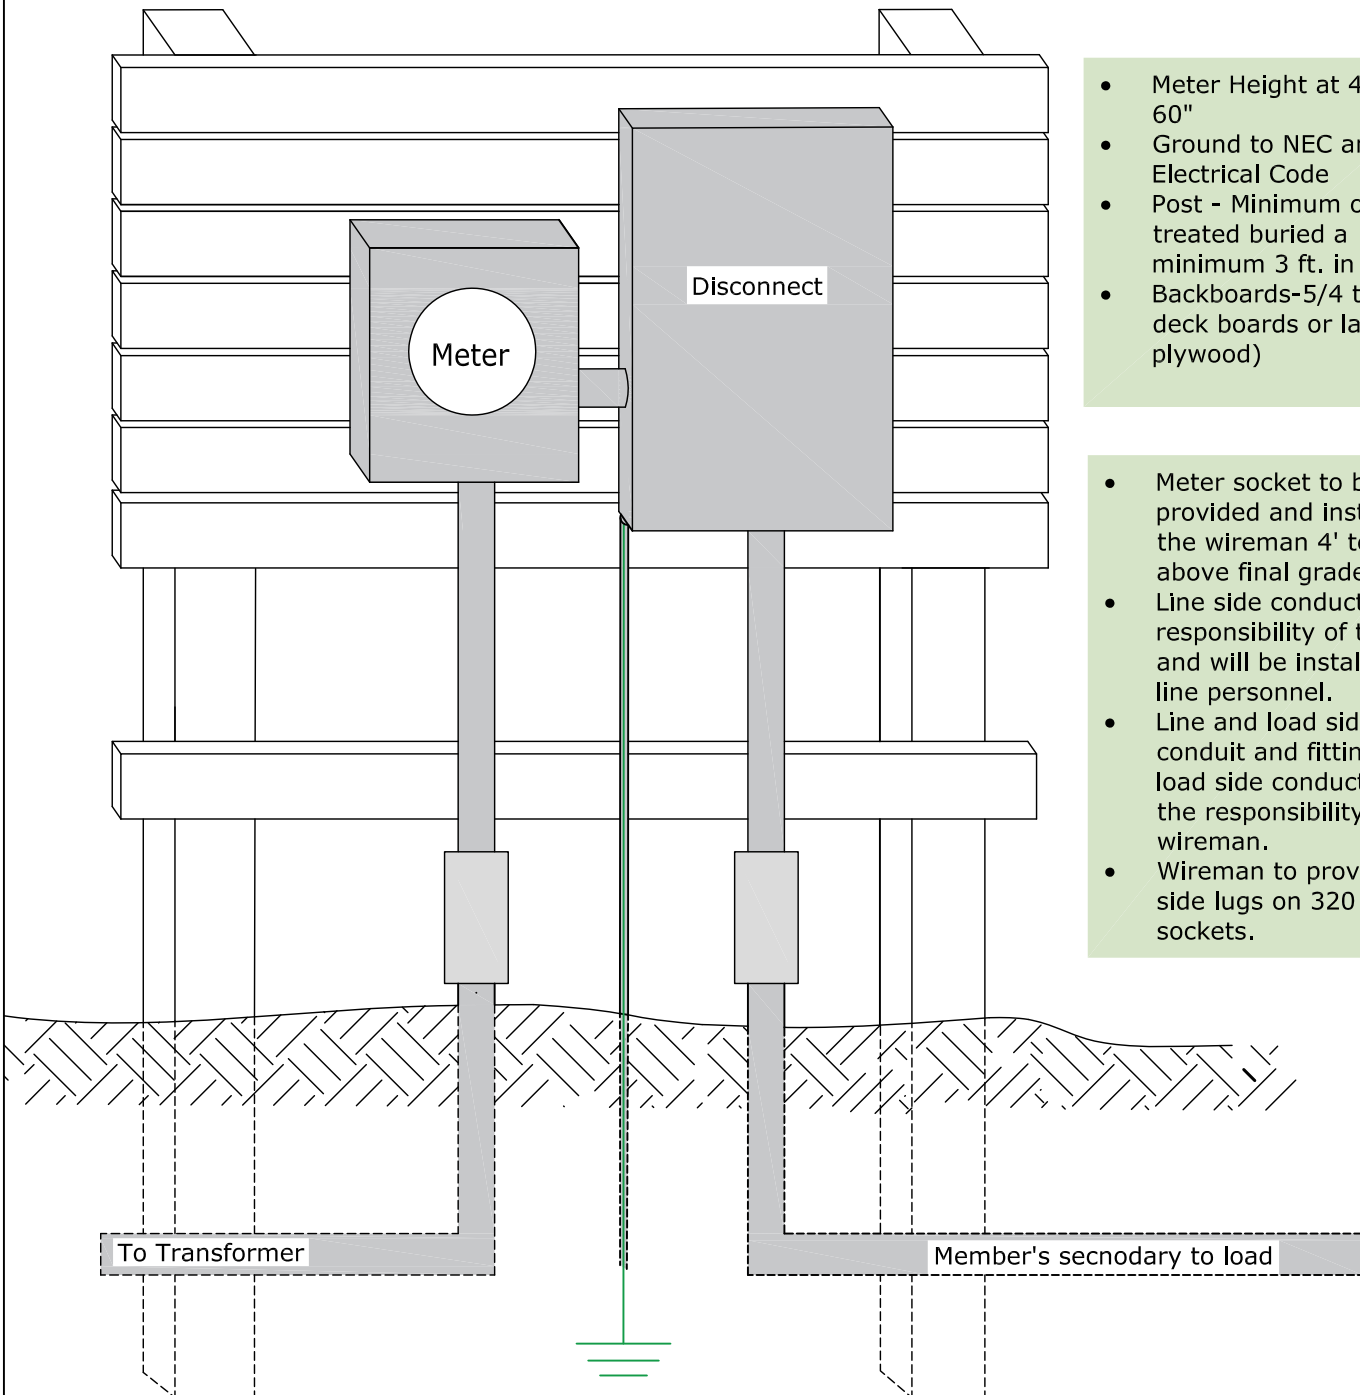

- Meter Height at 48" to 60"
- Ground to NEC and IA Electrical Code
- Post - Minimum of 6"x6" treated buried a minimum 3 ft. in ground
- Backboards-5/4 treated deck boards or larger (no plywood)

- Meter socket to be provided and installed by the wireman 4' to 6' above final grade.
- Line side conductor is the responsibility of the ACEC and will be installed by line personnel.
- Line and load side conduit and fittings plus load side conductor are the responsibility of the wireman.
- Wireman to provide line side lugs on 320 Amp sockets.

NOTE: Joint use of the ACEC trench is permitted with prior approval, with the exception of water and sewer systems.