
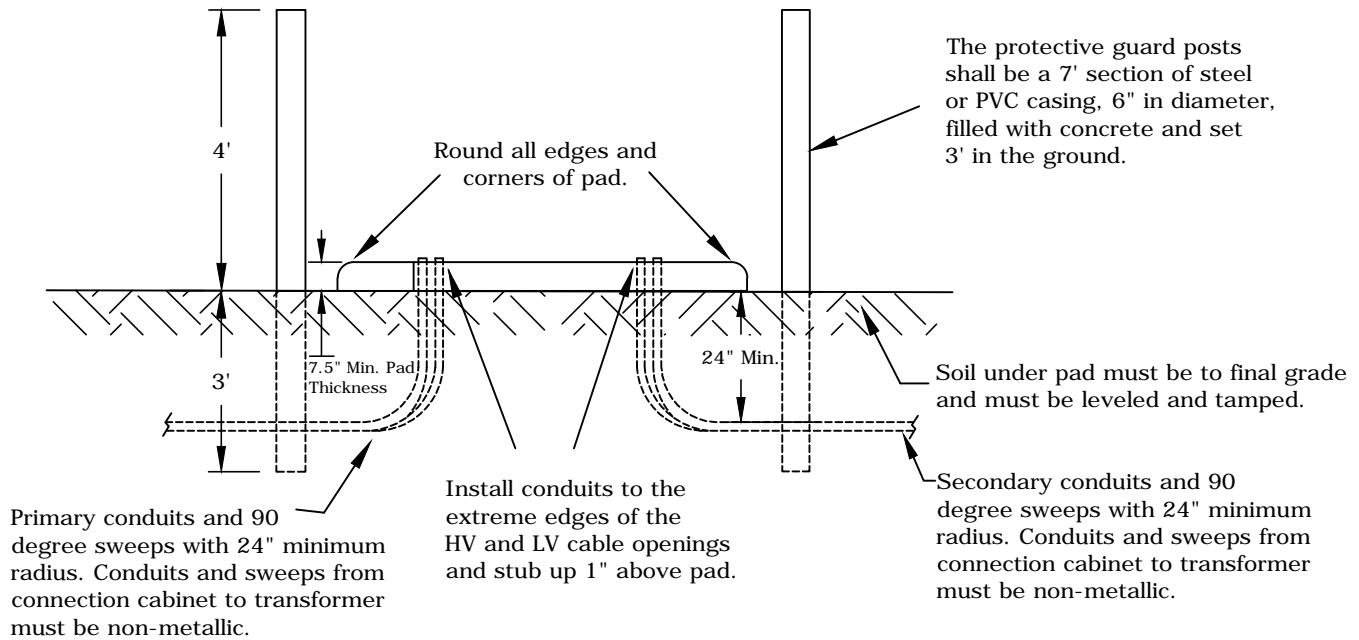


Transformer Concrete Pad and Protective Guard Post Specifications 45 to 1500 KVA 3PH Transformers

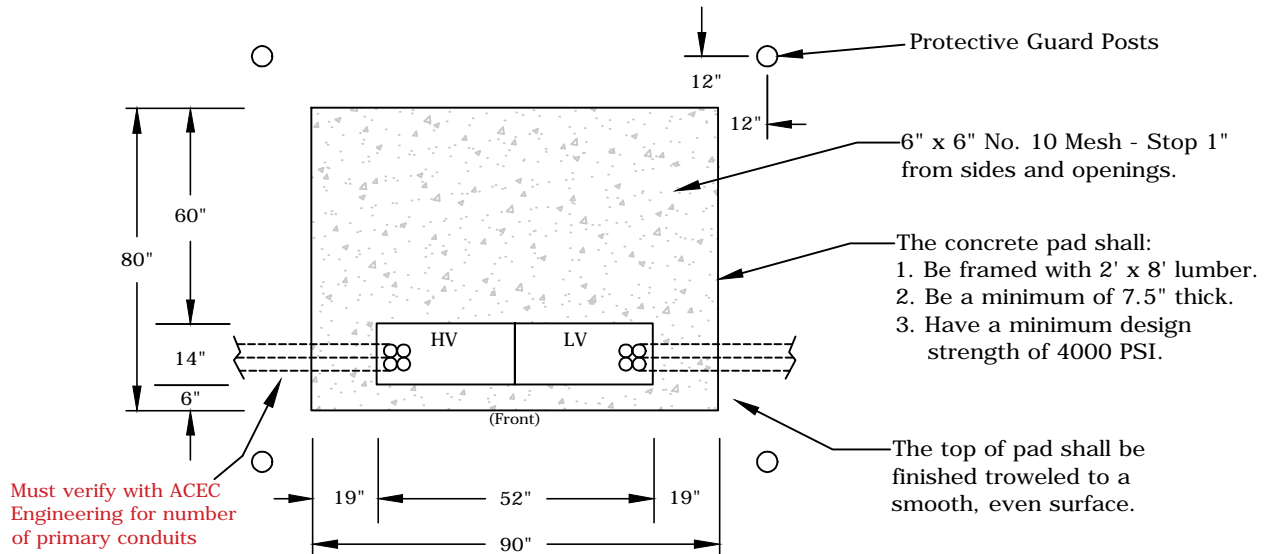

Note:

All primary and secondary conduits shall be installed before pad is set or poured.